

Intumescent Pipe Wraps

Firestop solution for plastic pipe penetrations

As part of the comprehensive Firepro range of fire protection products, Rockwool Corofil Intumescent offer a simple and more economic alternative to Firestop Pipe Collars for firestopping plastic pipework and electrical trunking in walls and floors. Tested to BS476 Part 20, Intumescent Pipe Wraps will provide up to 4 hours fire protection.

Advantages

- Simple to install
- No mechanical fixings
- Water resistant
- Maintenance free
- Available to suit pipe sizes up to 160mm O.D.
- Available to fit most electrical trunking sizes
- Available from order in 48 hours

Description

Pipe Wraps comprise layers of a graphite based intumescent sheet encapsulated in a polythene sheath.

Installation Instructions


The product is manufactured to be wrapped around the outside diameter of the pipework or trunking and is secured by means of a self-adhesive strip. The Intumescent Pipe Wrap is then positioned within the compartment wall or floor so that the edge of the product is left exposed at the face of the wall or soffit.

The Intumescent Pipe Wrap is then sealed into the structure with Rockwool Corofil Firestop Compound.


Under fire conditions, the intumescent material expands against the structure and fills the void left by the burnt out plastic.

For walls it may be necessary to fit two wraps depending on the fire risk areas concerned and if the wall thickness exceeds 150mm.


Where pipes are insulated, please refer to the Insulated Fire Sleeve data sheet.

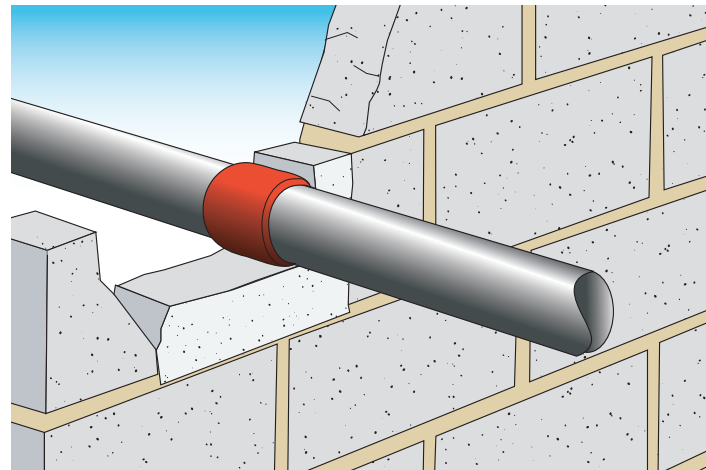

Intumescent Pipe Wrap sealed into compartment wall with Rockwool Corofil Firestop Compound

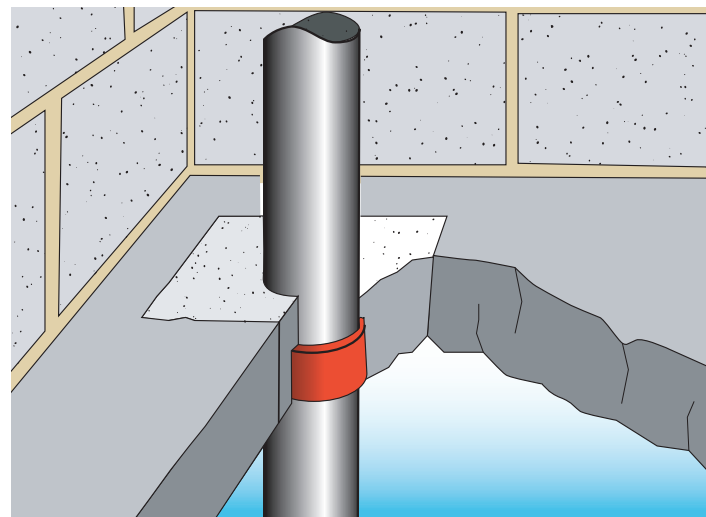

Intumescent Pipe Wrap sealed into compartment floor using Rockwool Corofil Firestop Compound

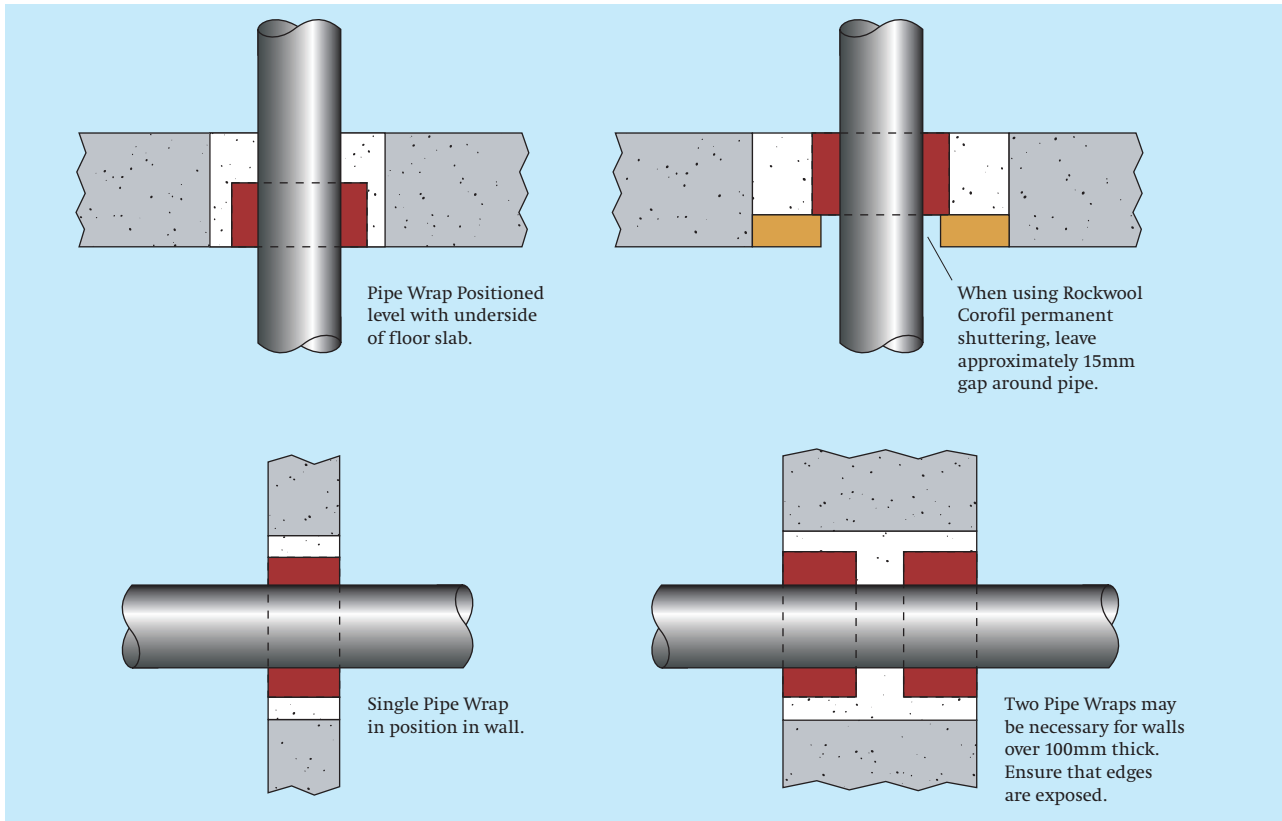

Fire Rating

Outside diameter of Pipework	2 Hour	4 Hour
	Pipe Wrap width	
55mm	50mm	100mm
82mm	50mm	100mm
110mm	50mm	100mm
160mm	100mm	100mm

All Pipe Wraps are supplied in correct length to suit pipe diameter.

Specification

Install Rockwool Corofil Intumescent Pipe Wraps to provide up to 4 hours fire protection to all plastic pipework and electrical trunking where they pass through fire rated walls and floors. Installation to be fully in accordance with manufacturer's instructions. See below for contact details.

Installation Instructions

Intumescent Pipe Wraps are used to prevent fire penetration in plastic pipes that pass through walls or floors for a specified period of up to 4 hours. They are manufactured as a sealed unit to the correct length and width to suit the pipe diameter and fire rating.

- 1) Check that the pipe surface is clear of mortar.
- 2) Ensure that the correct pipe wrap is installed to suit diameter and fire rating.
- 3) Wrap around pipe and fix with integral self-adhesive strip.
- 4) Slide into position ensuring that the bottom edge is exposed in a floor slab and both edges are exposed in a wall. Two wraps may be necessary when the wall thickness exceeds 100mm.
- 5) Seal the pipe wrap into the structure with Rockwool Corofil Fire Stop Compound.

Health and Safety

For further information relating to Health & Safety, please refer to the Intumescent Pipe Wraps Health and Safety data sheet, available from the Rockwool Marketing Services Department.

WILHAMS

Wilhams Insulation Far East Sdn Bhd (340166M)
 15 & 17 Jalan U5/23, Seksyen U5
 Mah Sing Integrated Industrial Park
 40150 Shah Alam, Selangor Darul Ehsan, Malaysia
 Tel: 603-7846 6728 Fax: 603-7846 6540
 E-mail: wilhams@wilhams.com.my